


Girl Bathroom Area:


1. Girl Camp area Hot water heater area. The circuit breaker panel is located on the South side of the shed. The circuit breaker panel contains breakers for the hot water heaters, circulation pump, and lighting in the bathrooms.
2. Valve # 2 should be open at all times. This is the supply line to the hot water system in the bathroom.
3. Valve # 3 is open when the circulating pump is operating, summer operation.
4. Valve # 3 is close when the circulating pump is not operating, winter operation.



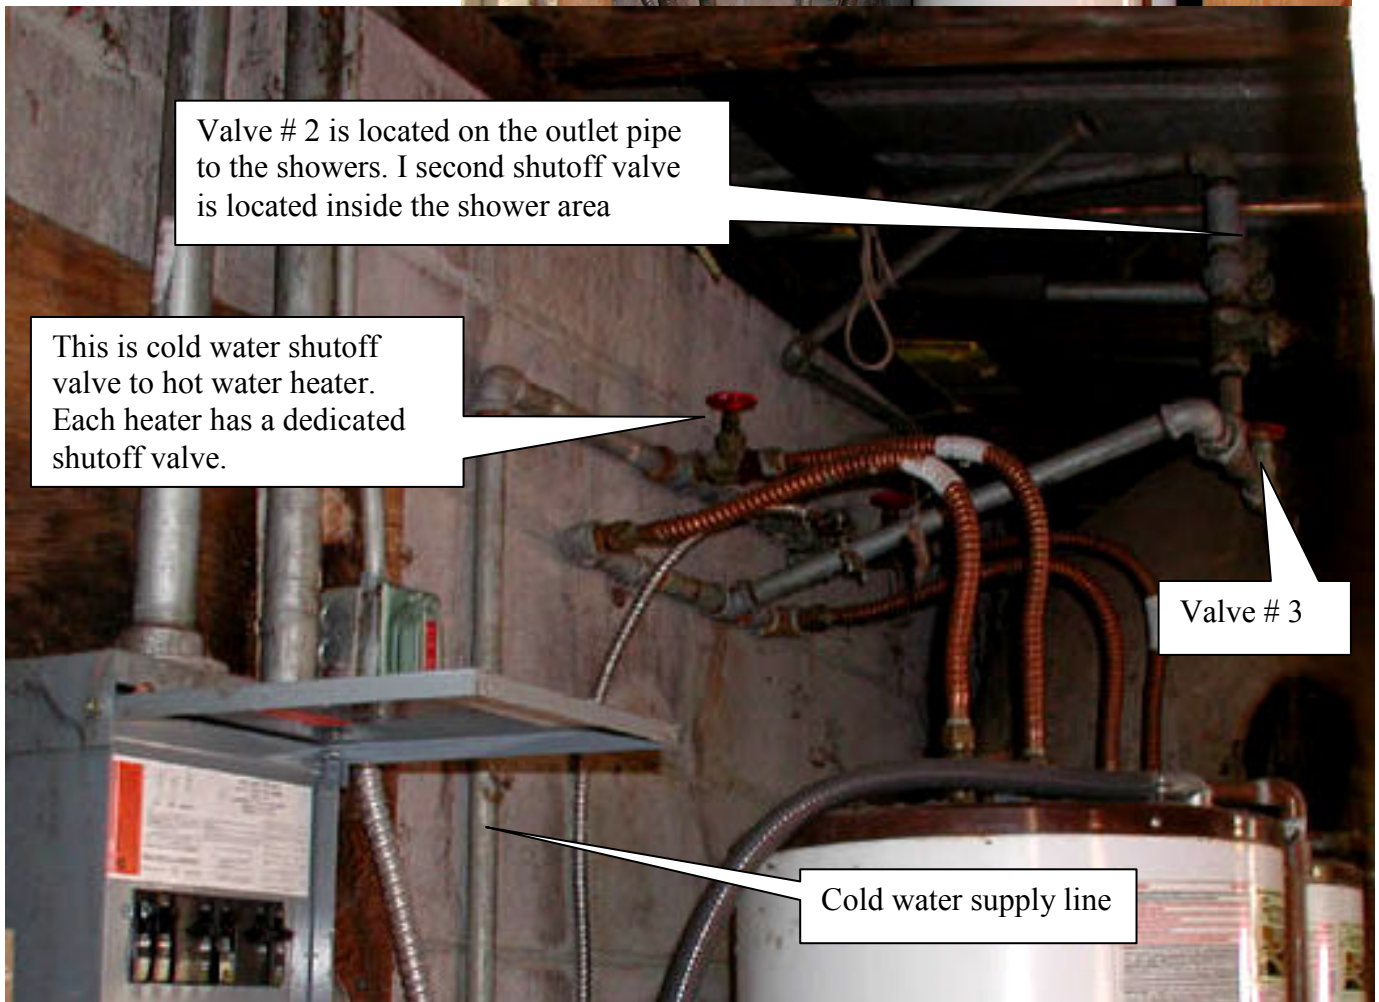


5. The panel contains circuit breakers for the water heater, location 3-4 and 6-7.
6. the circulating pump is hard wired in to the panel with a dedicated breaker which acts as an off / on switch also.
7. The remaining circuit breakers are for the lights in the bathrooms and the service outlet.

8. Valve # 1 only shuts the water supply to the hot water system only.

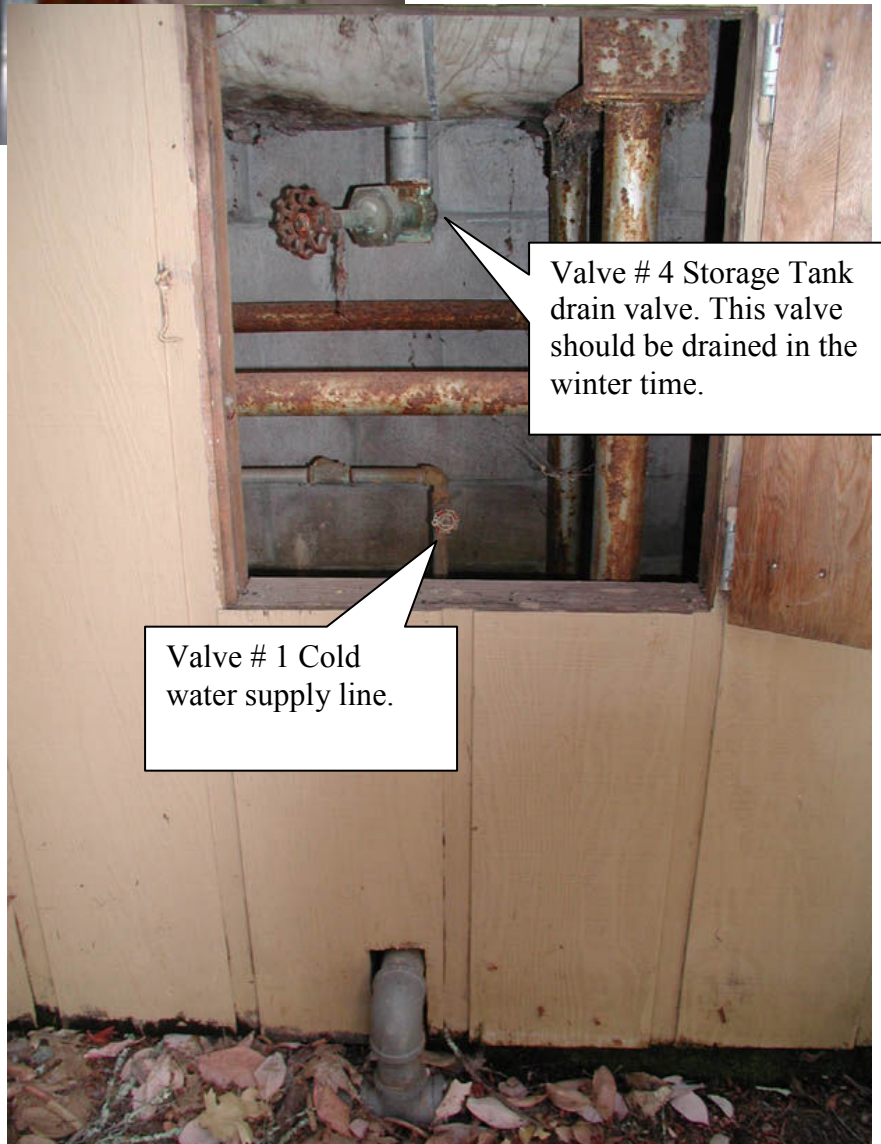

- 9. Valves # 5 and # 3 need to be in the open position when the circulating pump is in operation, summer operation.
- 10. Valves # 5 and # 3 need to be in the closed position when the circulating pump is not operating, winter operation.

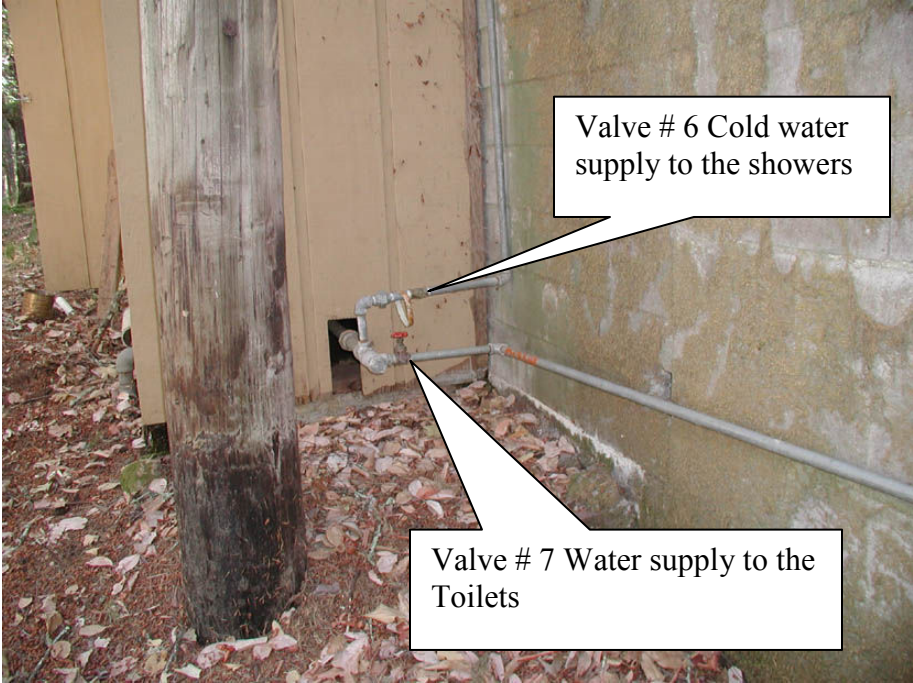

- 11. Toilet water system should be opened for the winter to drain the system once the water supply is shut off.

